


# Product Discontinued

## WLS + TEMPERATURE ELEMENTS Intrinsically Safe Wiring, I/O Connections

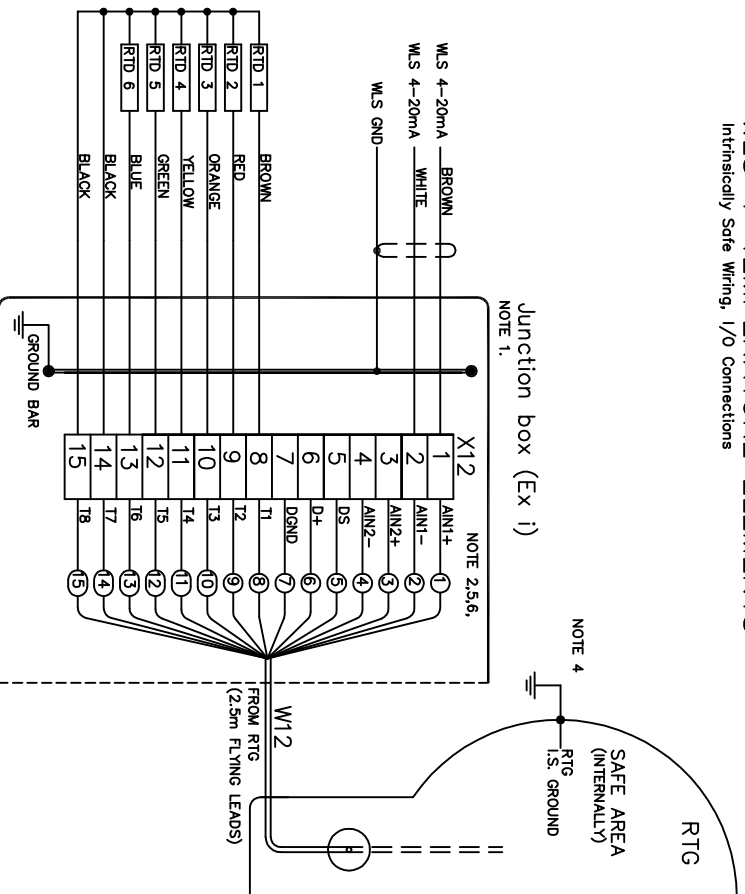

- ⑦ THE WLS CAN OPTIONAL BE CONNECTED TO AIN2 (3,4)
  - ⑥ THE TEMPERATURE MULTIPLEXER CARD (TMC) OPTION CONSISTS OF ONE INTRINSICALLY SAFE CIRCUIT FOR CONNECTION OF UP TO SIX RESISTANCE TEMPERATURE DETECTORS (SIMPLE APPARATUS).
- |       | U <sub>M</sub> | P <sub>0</sub> | U <sub>0</sub> | I <sub>0</sub> | C <sub>0</sub> | L <sub>0</sub> |
|-------|----------------|----------------|----------------|----------------|----------------|----------------|
| T1-T8 | 250V           | 0.3W           | 5.9V           | 179mA          | 43μF           | 0.7mH          |
- ⑤ EXTERNAL WIRING CONSISTS OF UP TO FOUR SEPARATE I.S. CIRCUITS. WIRES BELONGING TO DIFFERENT I.S. CIRCUITS MAY SHARE THE SAME CABLE, PROVIDED THEY ARE SEPARATED BY INDIVIDUAL SHIELDS CONNECTED TO GROUND. SEPARATE CABLES MUST BE USED IN INSTALLATIONS ACC. TO CSA.
  - ④ TANK EARTH CONNECTION MIN 4 SQMM REQUIRED FOR INST. ACC TO CENELEC.
  - ③ SHIELDED CABLE RECOMMENDED FOR VALID EMC PERFORMANCE ACC TO EN 50082-2. SHIELD CONNECTION ONLY AT ONE END OTHERWISE A GROUND LOOP WITH CIRCULATING CURRENT MAY OCCUR.
  - ② IF INTRINSIC SAFETY IS REQUIRED FOR ANY ONE OF THE CONNECTED DEVICES, THEN ALL CONNECTED DEVICES MUST BE CERTIFIED INTRINSICALLY SAFE AND COMPLY WITH THE TABLE (NOTE 6).
  - ① JBI (Junction Box Integrated) Ex i/ WIRE TERMINAL (X12) AWG 28-16 OR 0.08-1.5 SQMM OR CUSTOMER SUPPLIED JUNCTION BOX (OPTIONAL RTR SUPPLY) DEPENDING ON NATIONAL CODE OF PRACTICE.

ISSUED BY	WEEK	PRODUCT CODE	TITLE	INSTALLATION DRAWING TITLE
GSP-AJ	0211	REX	ACAD	WLS + TEMP CONNECTION
APPROVED BY	WEEK	ORIGINAL DWG NO.	SCALE	RTG (W12 / X12)
GSP	0211	9150 072-944	-	
<b>ROSEMOUNT</b>		1 <sup>ST</sup> ANGLE	DOC TYPE	DWG NO.
Tank Gauging			2	9150 072-944
				ISSUE SHEET
				3 1/1

THE CUSTOMER/USER OF THIS DOCUMENT IS RESPONSIBLE FOR OBTAINING THE NECESSARY PERMITS AND APPROVALS FOR THE USE OF THIS DOCUMENT IN ACCORDANCE WITH THE NATIONAL REGULATIONS AND STANDARDS. THE ROSEMOUNT COMPANY WILL NOT BE RESPONSIBLE FOR ANY DAMAGE OR LOSS OF DATA OR INFORMATION CAUSED BY THE USE OF THIS DOCUMENT. ROSEMOUNT TANK GAUGING, SWEDEN.