Product Discontinued

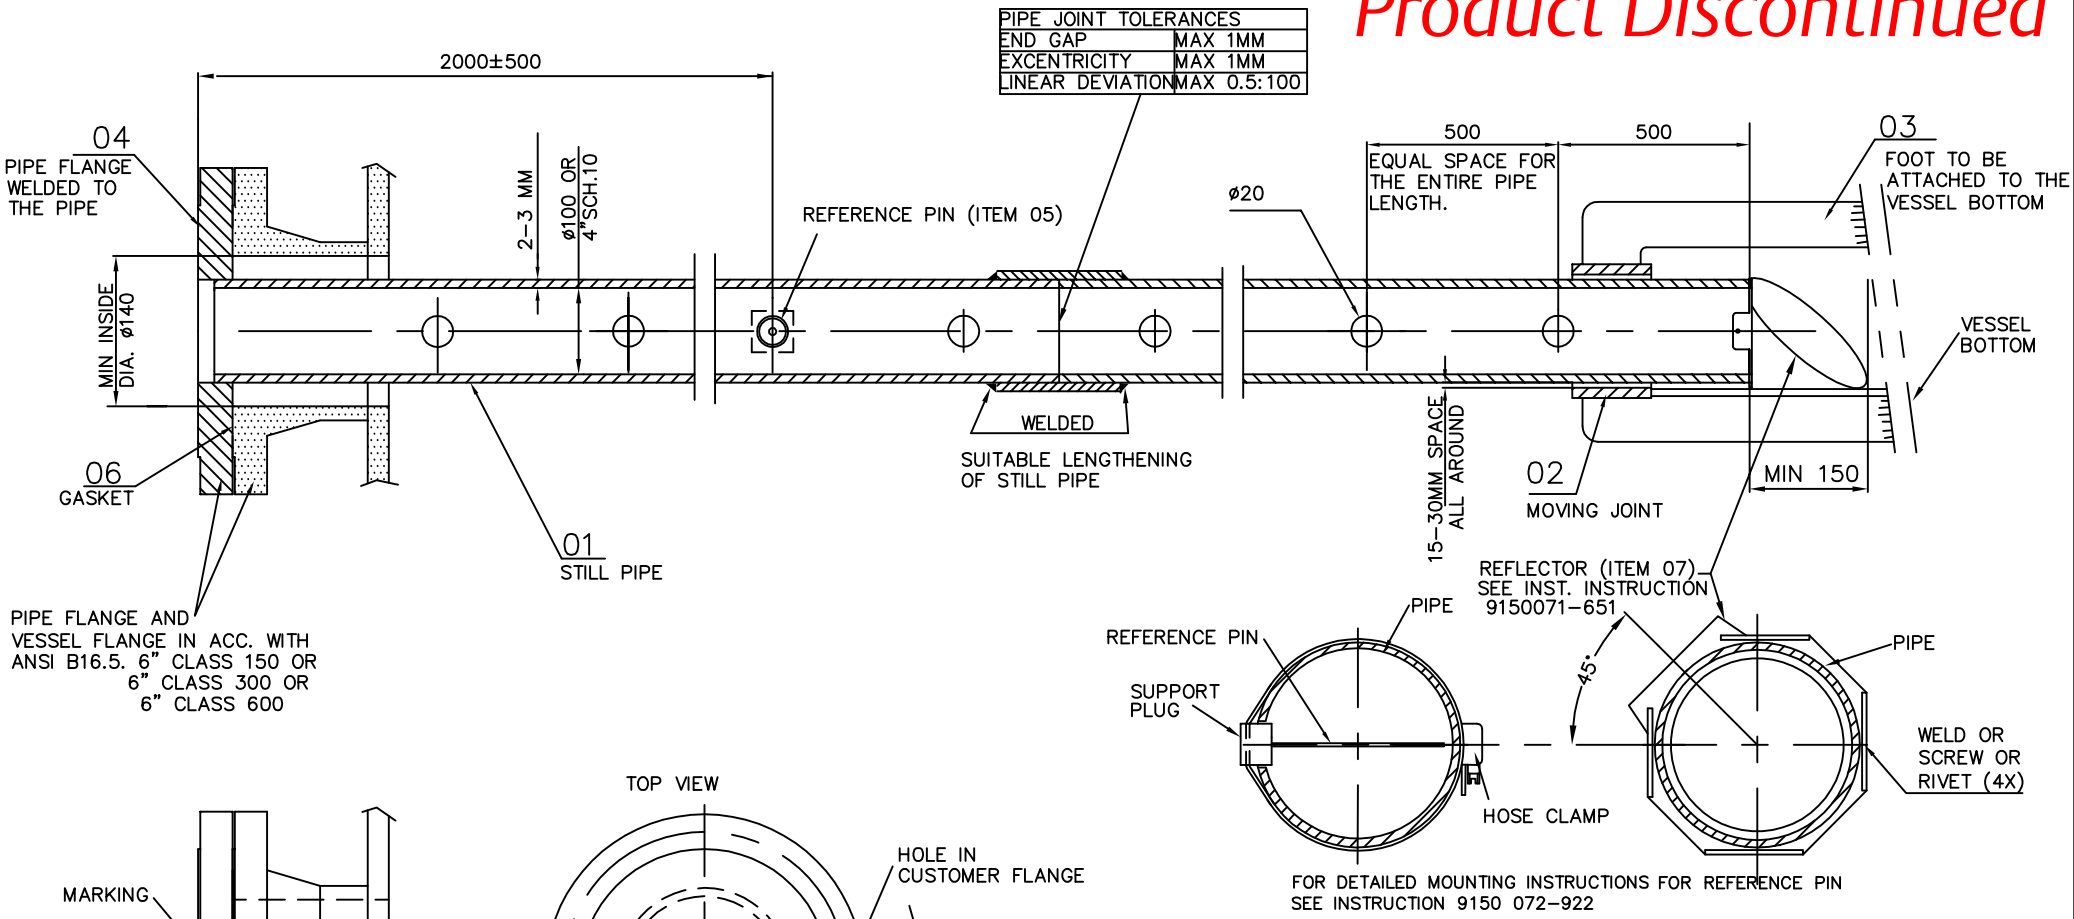

IMPORTANT:

REFERENCE PIN MUST BE DIRECTED TOWARDS ONE BOLT HOLE IN CUSTOMERS FLANGE. MARKING MUST BE DONE TO INDICATE THE POSITION OF THE REFERENCE PIN AND THE CORRESPONDING FLANGE HOLE WITHIN 1°. THIS MARKING IS TO BE USED DURING MOUNTING OF THE RTG.

FOR DETAILED REQUIREMENTS ON STILL PIPE INSTALLATION AND REFERENCE PIN, SEE DWG 9150 072-988

POS	ITEM DESCRIPTION	QTY	REMARK	SUPPLIER
07	REFLECTOR KIT	1	STAINLESS STEEL	RTR
06	GASKET		SOFT OR FLEXIBLE METALLIC TYPE	CUSTOMER
05	REFERENCE PIN KIT	1	STAINLESS STEEL	RTR
04	PIPE FLANGE	1	STAINLESS STEEL	CUSTOMER
03	FOOT	3	STAINLESS STEEL	CUSTOMER
02	MOVING JOINT (RING/PIPE)	4	STAINLESS STEEL	CUSTOMER
01	STILL PIPE Di ø100 OR 4"SCH.10	1	STAINLESS STEEL	CUSTOMER

ISSUED BY	WEEK	PRODUCT CODE	FILE
GSP-MH	0027	REX	ACAD

APPROVED BY	WEEK	ORIGINAL DWG NO.	SCALE
GU-HF	0027	9150 072-924	-

INSTALLATION DRAWING TITLE: MECHANICAL INSTALLATION DWG FOR LPG/LNG STILL PIPE ATTACHED TO THE VESSEL FLANGE. (ALT. B)

ROSEMOUNT Tank Gauging

1 ST ANGLE

DOC TYPE	DWG NO.	ISSUE	SHEET
2	9150 072-924	3	1/1

THE COPYRIGHT/OWNERSHIP OF THIS DOCUMENT IS AND WILL REMAIN OURS. THE DOCUMENT MUST NOT BE USED WITHOUT OUR AUTHORIZATION OR BROUGHT TO THE KNOWLEDGE OF A THIRD PARTY. CONTRAVENTION WILL BE PROSECUTED. ROSEMOUNT TANK RADAR AB, SWEDEN.

INST. DWG. A3 070213