

Online Gas Analysis of Hydrogen-cooled Generators

Application

Emerson Process Management offers Rosemount Analytical gas analyzer technology to provide on-line analysis of hydrogen-cooled electric power generators to improve both profitability and operational safety.

Background

Early electric generators were air-cooled, but as generators became increasingly larger, the use of air as a cooling medium became inadequate. Larger generators produced more heat and required more intense cooling procedures. These larger generators also introduced other complications such as windage losses caused by wind resistance and friction on the spinning generator shaft.

Helium was considered for cooling, but helium was not found in abundance and, as a result, cost much more than other gases. Hydrogen, however, was readily available and had a thermal conductivity much higher than air which made hydrogen a very good cooling medium. Additionally, hydrogen had a much lower viscosity than air. This significantly decreased the windage losses, thus increasing the efficiency of the generator. Around 1937, hydrogen replaced air as the primary gas used to remove heat from stator windings, rotor windings, and stator core iron in larger generators.

However, hydrogen poses fire hazards that are not a concern with air or helium. Fortunately, hydrogen does not support combustion in a nearly pure state (> 90%) with a balance of air. With proper operation, including the use of on-line gas analysis, fire hazards can be almost completely eliminated.

Gas Analyzer Application

On-line gas analysis is used in hydrogen-cooled generators for the following purposes:

- Commercial: maintaining a high concentration of hydrogen coolant increases the cooling efficiency of the generator (For cost of decreased hydrogen purity, see Figure 1).
- Safety - Explosion: air in the hydrogen coolant can quickly lead to an explosive condition.
- Safety - Maintenance: air must be present inside the generator before personnel can perform maintenance inside the generator.



Maintenance of a Hydrogen-cooled Generator

Measurements need to be done during normal operation and during start-up and shutdown purging operations. During normal operation, the hydrogen purity is monitored in an 80 to 100 % H₂ range to detect air leaks or hydrogen supply problems. During the start-up of a hydrogen-cooled generator, air in the generator is first displaced with carbon dioxide.

After the first purge operation is complete, the generator is filled with hydrogen. During shutdown, typically for maintenance, the opposite scenario takes place. During start-up and shutdown, monitoring the carbon dioxide and hydrogen helps the operators minimize start-up and shutdown time, and keeps the maintenance operation safe since they know from analyzer reading when the purge cycle is complete.

A thermal conductivity analyzer set up with two measurements is typically used for this application:

- Measurement 1: 0–100 % H₂ in CO₂/air or 80–100 % H₂ in air (adjustable)
- Measurement 2: 0–100 % CO₂ in air

Start-up Mode

Hydrogen must replace other gases for efficient generator operation

- First purge operation during start-up:
 - Ambient air is first replaced by CO₂, since mixing H₂ directly with air would produce an unsafe condition.
 - Measure 0–100 % CO₂ (with air as background)
- Second purge operation during start-up:
 - CO₂ is then safely replaced with H₂
 - Measure 0–100 % H₂ with special linearization 0–40 % H₂ (with CO₂ as background gas), 40–80 % H₂ (extrapolation between air and CO₂ as background gas), 80–100 % H₂ (with air as background gas)

Operation Mode

Hydrogen purity needs to be measured.

- Measure 80–100 % H₂ (with air as background gas)

Maintenance Mode


Breathing air must replace other gases before personnel can perform maintenance inside the generator.

- First purge operation during shutdown for maintenance:
 - H₂ is first replaced with CO₂, since mixing air directly with H₂ would produce an unsafe condition
 - Measure 0–100 % H₂ with special linearization
- Second purge operation during shutdown for maintenance:
 - CO₂ is then safely replaced with breathing air
 - Measure 0–100 % CO₂ (with air as background gas)

Setup Options

The analyzer comes standard with two measurements and two analog outputs. Measurement 1: 0–100 % H₂ in CO₂/air is zoomed to 80–100 % H₂ in air. Customers can switch manually to 0–100 % H₂ in

Figure 1 - Cost of Decreased Hydrogen Purity

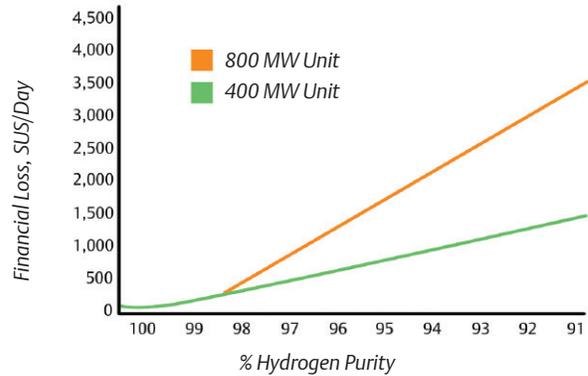

CO₂/air. Switching between both ranges of measurement 1 can also be done automatically.

The instrument is setup to provide a zoom indicator on digital output 4, so the customer can monitor the zoom status. Measurement 2 detects 0–100 % CO₂ in air.

Optionally, a three-measurement configuration is also possible:

- 80–100 % H₂ in air
- 0–100 % CO₂ in air
- 0–100 % H₂ in CO₂/air

For this configuration a third analog output has to be ordered. Emerson can supply either a Rosemount Analytical X-STREAM flameproof analyzer or an X-STREAM purged/pressurized analyzer for this application. The analyzer can be used to ensure power plant safety, and to maximize the efficiency and profitability of running the generator.

www.RosemountAnalytical.com

EUROPE

Emerson Process Management GmbH & Co. OHG
 Rosemount Analytical
 Analytical Center of Excellence
 Industriestrasse 1
 63594 Hasselroth, Germany
 T +49 6055 884 0
 F +49 6055 884 209
pga.info@emerson.com



ASIA-PACIFIC

Emerson Process Management
 Asia Pacific Private Limited
 1 Pandan Crescent
 Singapore 128461
 Republic of Singapore
 T +65 6 777 8211
 F +65 6 777 0947
analytical@ap.emersonprocess.com

MIDDLE EAST AND AFRICA

Emerson Process Management
 Emerson FZE
 P.O Box 17033
 Jebel Ali Free Zone
 Dubai, United Arab Emirates
 T +971 4 811 8100
 F +971 4 886 5465
analytical@ap.emersonprocess.com

AMERICAS

Emerson Process Management
 Rosemount Analytical
 Analytical Center of Excellence
 10241 West Little York, Suite 200
 Houston, TX 77040 USA
 Toll Free 866 422 3683
 T +1 713 396 8880 (North America)
 T +1 713 396 8759 (Latin America)
 F +1 713 466 8175
gc.csc@emerson.com

©2013 Emerson Process Management. All rights reserved.

The Emerson logo is a trademark and service mark of Emerson Electric Co. Rosemount Analytical is a mark of one of the Emerson Process Management family of companies. All other marks are the property of their respective owners.

The contents of this publication are presented for information purposes only, and while effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available on request. We reserve the right to modify or improve the designs or specifications of our products at any time without notice.