



ISSUE	CHANGE ORDER No	WEEK	ISSUE	CHANGE ORDER No	WEEK	ISSUE	CHANGE ORDER No	WEEK
1	SME-6175	0936	2	SME-7571	1306			

HAZARDOUS LOCATION

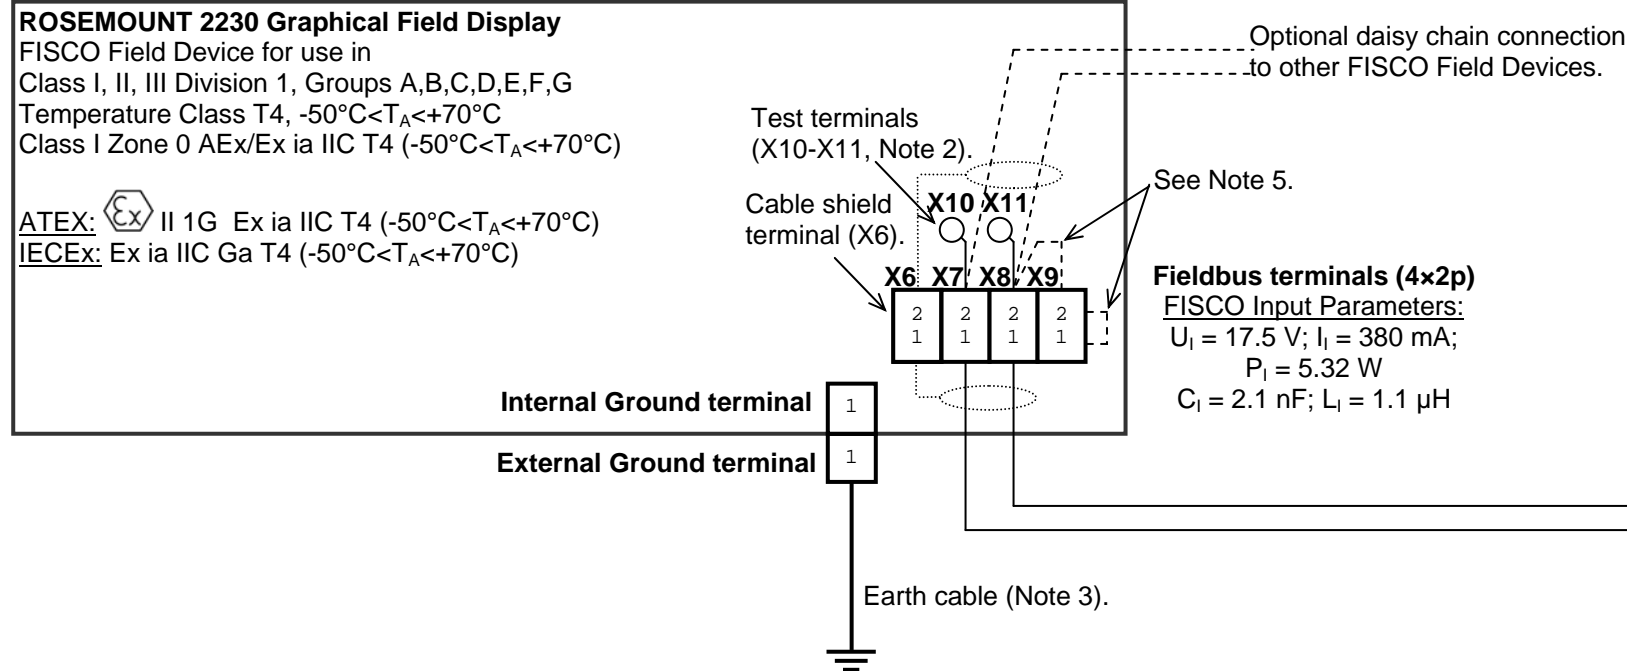

HAZARDOUS OR NON-HAZARDOUS LOCATION

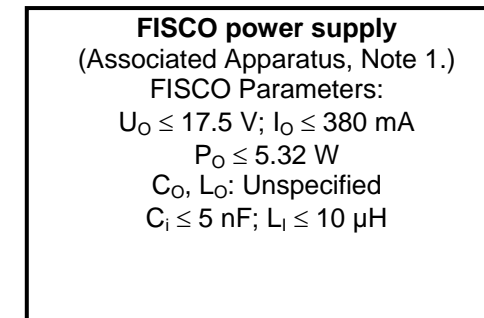

FIELD BUS INTRINSICALLY SAFE CONCEPT (FISCO) APPROVAL

FISCO allows interconnection of intrinsically safe apparatus to associated apparatus not specifically examined in such combination. The criteria for interconnection is that the voltage (U_i or V_{MAX}), current (I_i or I_{MAX}) and power (P_i or P_{MAX}) which an intrinsically safe apparatus can receive and remain intrinsically safe considering faults, must be equal to or greater than the voltage (U_o, V_{OC} or V_i), current (I_o, I_{SC} or I_i) and power (P_o or P_{MAX}) levels which can be delivered by the Associated Apparatus, considering faults and applicable factors. In addition, the maximum unprotected capacitance (C_i) and the inductance (L_i) of each apparatus (other than the termination) connected to the Fieldbus must be less than or equal to 5 nF and 10 μH respectively.

In each I.S. Fieldbus segment only one active device, normally the Associated Apparatus, is allowed to provide the necessary energy for the Fieldbus. The voltage (U_o, V_{OC} or V_i) of the Associated Apparatus is limited to a range of 14 V to 17.5 V. All other equipment connected to the bus cable has to be passive, meaning that they are not allowed to provide energy to the system, except a leakage current of 50 μA for each connected device. Separately powered equipment needs galvanic isolation to assure that the intrinsically safe Fieldbus circuit remains passive.

The cables used to interconnect devices need to have characteristics in the following range:

- Loop Resistance R_C : 15.....150 ohm/km
- Loop Inductance L_C : 0.4.....1 mH/km
- Capacitance per unit length C_C : 45.....200 nF/km
- $C_C = C_{\text{line to line}} + 0.5 \times C_{\text{line to screen}}$ if both lines are floating or
- $C_C = C_{\text{line to line}} + C_{\text{line to screen}}$ if screen is connected to one line
- Length of trunk cable: Less than or equal to 1 km
- Length of spur cable: Less than or equal to 60 m

At each end of the trunk cable an approved infallible line terminator with the following parameters should be installed: $R \geq 90 \text{ ohm}$, $C \leq 2.2 \mu\text{F}$ (recommended parameters are: $R = 100 \pm 2 \text{ ohm}$, $C = 1.0 \pm 0.2 \mu\text{F}$).

One of the allowed terminations may be integrated in the Associated Apparatus.

This Field Device is also equipped with an integrated terminator; see note 5.

FISCO limits the number of passive devices connected to a single segment to 32 devices. If the above rules are respected, a total length of up to 1 km of cable is permitted (sum of trunk and spur cables). The inductance and capacitance of the cable will not impair the intrinsic safety of the installation.

Notes:

- Control equipment connected to the Associated Apparatus must not use or generate more than 250 V_{RMS} or V_{DC} .
- Test terminals for temporary connection of Intrinsically Safe Rosemount 375 or 475 Field Communicator.
- Earth connection cable area: min. 4 mm^2 .
- Installation should be in accordance with IEC 60079-14 "Electrical Installations in Hazardous Areas (other than mines)" or according to a valid national standard or code of practice for hazardous area installations. Installation in the USA should be in accordance with ANSI/ISA-RP12.6 "Installation of Intrinsically Safe Systems for Hazardous (Classified) Locations" and the National Electrical Code (ANSI/NFPA 70). Dust tight conduit seals must be used when installed in Class II and Class III environments.
- A built-in Fieldbus terminator can be invoked by connecting a jumper between either X8:2-X9:2 or X9:2-X9:1.

WARNING: To prevent ignition of flammable or combustible atmospheres, read, understand and adhere to the manufacturer's live maintenance procedures.
WARNING: Substitution of components may impair Intrinsic Safety.


FM APPROVED PRODUCT
 No revision to this drawing without prior Factory Mutual approval

9240040-949	ISSUED BY EE-RJ	WEEK 1007	PRODUCT CODE 2230		TITLE SYSTEM CONTROL DWG FM Rosemount 2230	
	APPROVED BY EAp	WEEK 1007	DOC. TYPE 6	FILE OrCAD		
	ALL DIMENSIONS ARE IN MILLIMETRES. TOLERANCES, UNLESS OTHERWISE STATED:			FINISH, UNLESS OTHERWISE STATED:		DWG NO. 9240040-949
	ROSEMOUNT			1 ST ANGLE	SCALE	ISSUE 2
					SHEET 1/2	
The copyright/ownership of this document is and will remain ours. The document must not be used without our authorization or brought to the knowledge of a third party. Contravention will be prosecuted. Rosemount Tank Radar AB, Sweden						

ISSUE	CHANGE ORDER No	WEEK	ISSUE	CHANGE ORDER No	WEEK	ISSUE	CHANGE ORDER No	WEEK
1	SME-6175	0936	2	SME-7571	1306			

PRELIMINARY

HAZARDOUS LOCATION

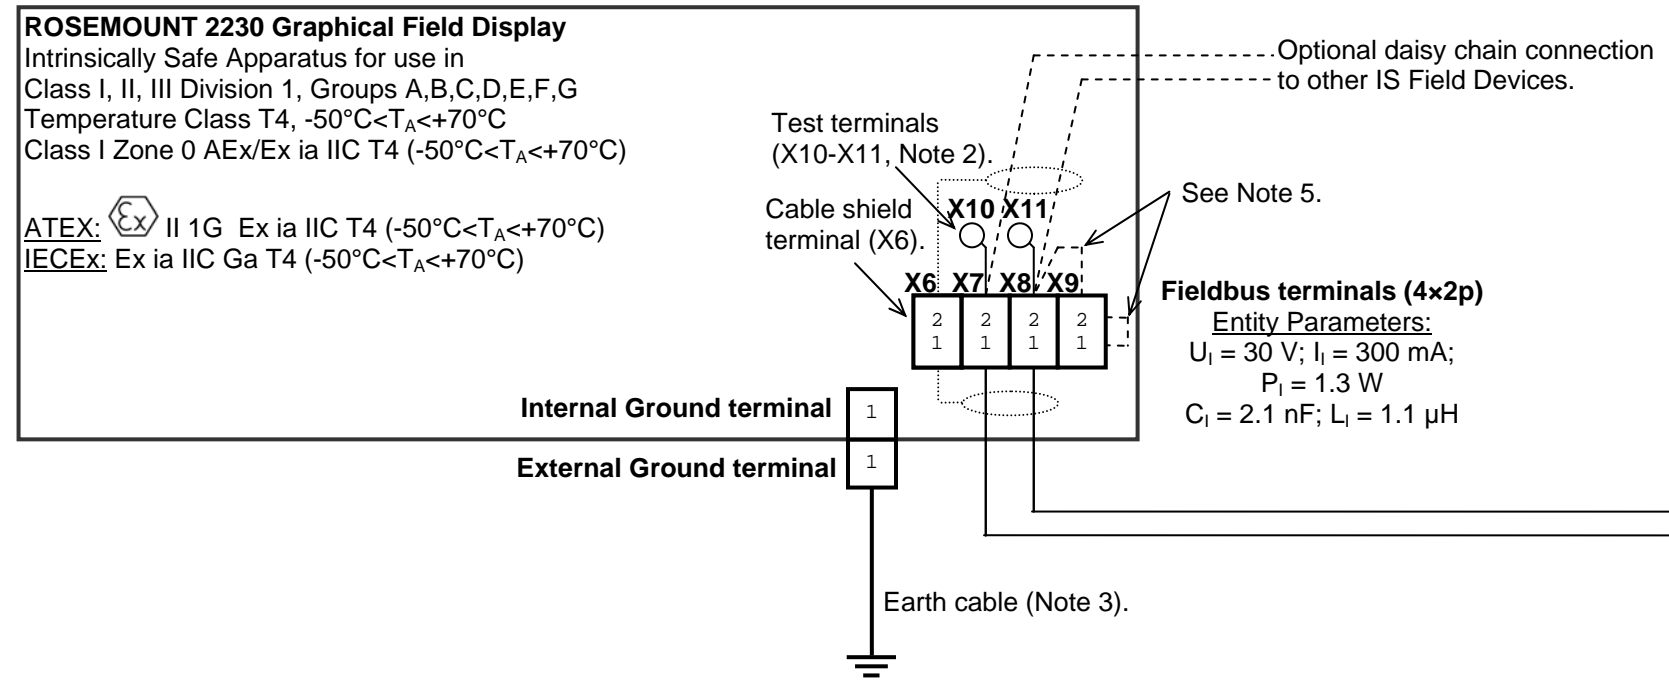

HAZARDOUS OR NON-HAZARDOUS LOCATION

Intrinsically Safe power supply
(Associated Apparatus, Note 1.)

Entity Parameters:
 $U_o \leq 30 \text{ V}$; $I_o \leq 300 \text{ mA}$; $P_o \leq 1.3 \text{ W}$
 $C_o \geq$ Total capacitance of connected cables and Fieldbus Devices.
 $L_o \geq$ Total inductance of connected cables and Fieldbus Devices.

ENTITY CONCEPT APPROVAL

The Entity concept allows interconnection of intrinsically safe apparatus to associated apparatus not specifically examined in combination as a system. The approved values of max. open circuit voltage (U_o , V_{OC} or V_i), max. short circuit current (I_o , I_{SC} or I_i) and max. power (P_o or $V_{OC} \times I_{OC} / 4$ or $V_i \times I_i / 4$), for the associated apparatus must be less than or equal to the maximum safe input voltage (U_i or V_{MAX}), maximum safe input current (I_i or I_{MAX}) and maximum safe input power (P_i or P_{MAX}) of the intrinsically safe apparatus. In addition, the approved max. allowable connected capacitance (C_o or C_a) of the associated apparatus must be greater than the sum of the interconnecting cable capacitance and the unprotected internal capacitance (C_i) of the intrinsically safe apparatus, and the approved max. allowable connected inductance (L_o or L_a) of the associated apparatus must be greater than the sum of the interconnecting cable inductance and the unprotected internal inductance (L_i) of the intrinsically safe apparatus.

Notes:

- Control equipment connected to the Associated Apparatus must not use or generate more than $250 V_{RMS}$ or V_{DC} .
- Test terminals for temporary connection of Intrinsically Safe Rosemount 375 or 475 Field Communicator.
- Earth connection cable area: min. 4 mm^2 .
- Installation should be in accordance with IEC 60079-14 "Electrical Installations in Hazardous Areas (other than mines)" or according to a valid national standard or code of practice for hazardous area installations. Installation in the USA should be in accordance with ANSI/ISA-RP12.6 "Installation of Intrinsically Safe Systems for Hazardous (Classified) Locations" and the National Electrical Code (ANSI/NFPA 70). Dust tight conduit seals must be used when installed in Class II and Class III environments.
- A built-in Fieldbus terminator can be invoked by connecting a jumper between either X8:2-X9:2 or X9:2-X9:1.

WARNING: To prevent ignition of flammable or combustible atmospheres, read, understand and adhere to the manufacturer's live maintenance procedures.
WARNING: Substitution of components may impair Intrinsic Safety.

FM APPROVED PRODUCT
No revision to this drawing without prior Factory Mutual approval

9240040-949	ISSUED BY EE-RJ	WEEK 1007	PRODUCT CODE 2230		TITLE SYSTEM CONTROL DWG FM Rosemount 2230	
	APPROVED BY EAp	WEEK 1007	DOC. TYPE 6	FILE OrCAD		
	ALL DIMENSIONS ARE IN MILLIMETRES. TOLERANCES, UNLESS OTHERWISE STATED:			FINISH, UNLESS OTHERWISE STATED:		DWG NO. 9240040-949
	ROSEMOUNT		1 ST ANGLE	SCALE	ISSUE SHEET 2 2/2	

The copyright/ownership of this document is and will remain ours. The document must not be used without our authorization or brought to the knowledge of a third party. Contravention will be prosecuted.
Rosemount Tank Radar AB, Sweden