FOR REFERENCE ONLY - DRAWING NOT TO SCALE

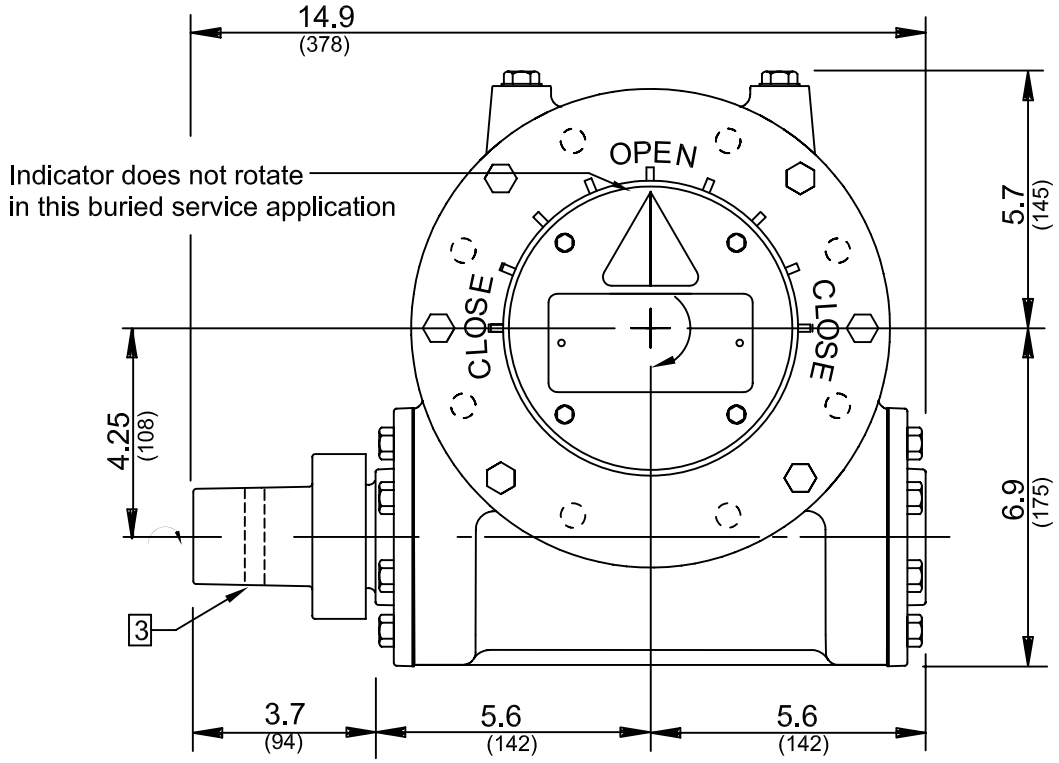

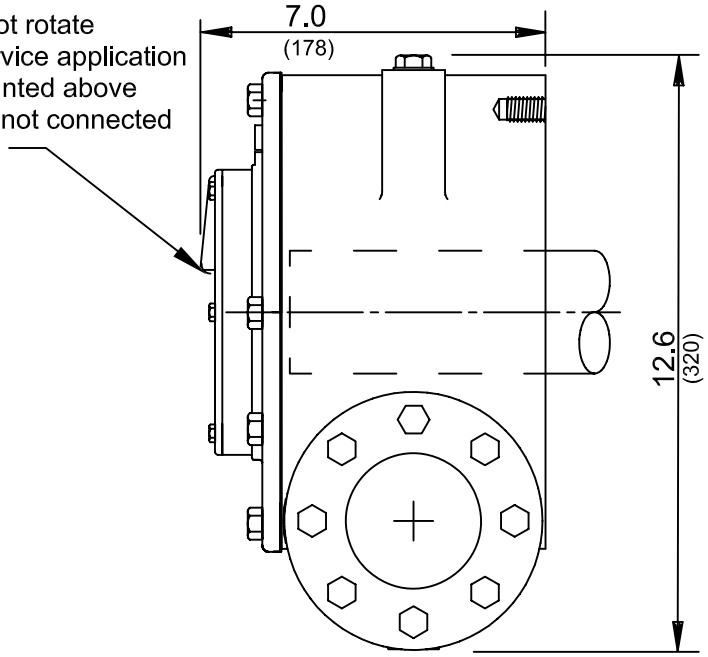

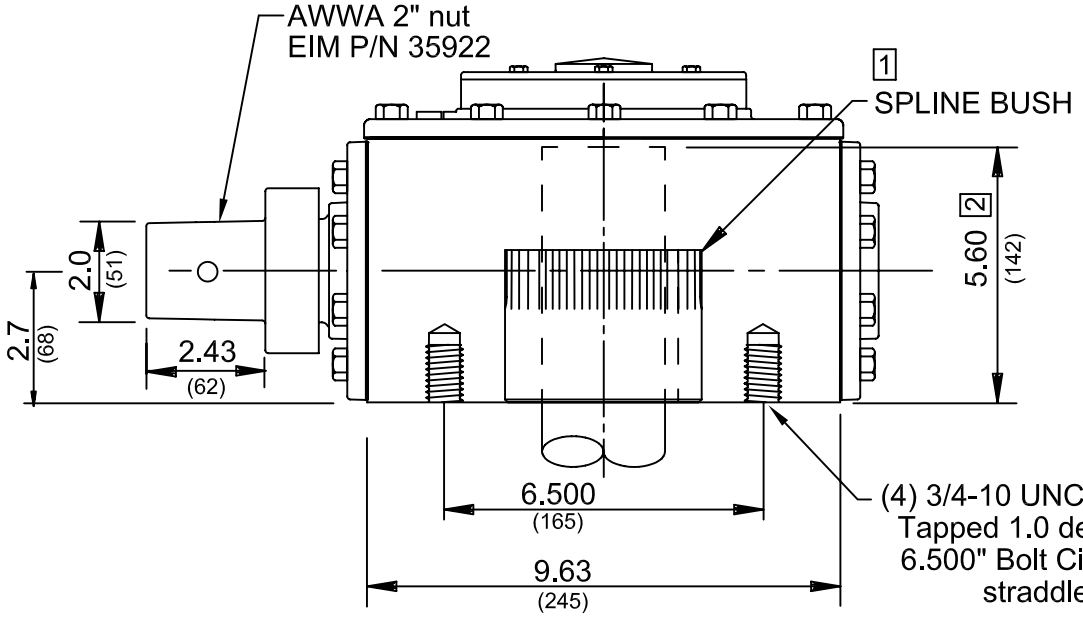

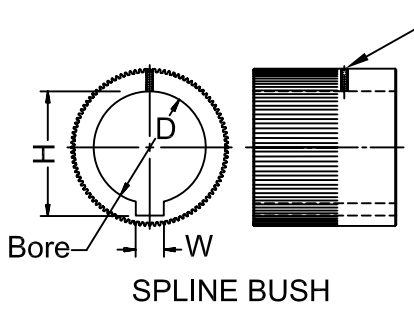

Do not use set screw as a permanent locating method on valve shaft. Use a change in shaft diameter.

1 Spline Bush: Removable from the bottom of actuator. Refer to EIM Job Spec sheet for Bushing furnished for specific application.

2 Maximum Valve Stem Length

3 Stainless Steel Pin 3/8 X 2.00
EIM P/N 4043002073

Special Note: Industry standards for manual actuators generally require Clockwise (CW) rotation of handwheel to close valve with Clockwise (CW) rotation of valve shaft. EIM Model WB30-B has CW rotation of actuator input shaft for CW rotation of valve input shaft.

INCHES (MILLIMETERS) .XXX ± .005" .XX ± .020" .X APPROX.

EIM CONTROLS
EIM COMPANY, INC.
13840 PIKE ROAD
MISSOURI CITY, TX 77489

WB30-B 6.50"

REV	DATE	ERO	BY
B	6/29/04	13801	CML
A	3/11/98		CML

OUTLINE NO.: 72394-B REV B