

Rosemount™ Compact Flowmeter Performance in Cryogenic Applications

Recent testing shows standard Rosemount Compact Flowmeter configurations to be accurate and reliable in cryogenic liquid metering. This testing at the NIST (National Institute of Standards and Technology) Cryogenic Flow Measurement Facility proves the performance of the meter in cryogenic applications.

1.0 Background

Industrial gases are often moved or stored in a cryogenic liquid state, that is, at cold temperatures and pressures slightly above vapor pressure. In addition to industrial gases, natural gas is now often liquefied (referred to as LNG) and transported great distances to market. Flow metering in these conditions presents special challenges, the solutions to which are the subject of this paper.

At cryogenic conditions, these liquids provide little lubrication for moving parts and therefore create major challenges for traditional turbine and positive displacement flowmeters. Additionally, the large temperature gradient presents concerns when O-rings, glands, welds, or dissimilar metals are present in the flow stream. As a result, reliable measurement of cryogenic liquids is difficult with traditional flow metering technologies.

Rosemount Compact Flowmeter Series and 405 Compact Primary Elements from Emerson™ are well-suited to the measurement of cryogenic liquids because there are no welds in the flow stream and the integral neck tube removes the transmitter from direct contact with the cryogenic liquid.



Rosemount 3051SFC Compact Conditioning Differential Pressure Flowmeter

2.0 Flow lab information

National Institute of Standards and Technology

Cryogenic Flow Measurement Facility (CFMF)


325 Broadway

Boulder, CO 80302

3.0 Testing and discussion of results


A Rosemount 3051SFC Compact Conditioning Flowmeter was installed and tested in the NIST laboratory cryogenic flow loop located in Boulder, Colorado. Two Rosemount 3051S DP Transmitters were also used and remote mounted for comparison. The lab uses liquid nitrogen (LN2) as a flowing media, with a boiling point of 77 K (-321 °F or -196 °C). This provides a good comparison to performance in Liquefied Natural Gas (LNG) since LNG has a boiling point of 111 °K (-259 °F or -161 °C). A flow calibration was performed to determine the performance of the flowmeter in cryogenic service. Figure 1-2 shows the results were excellent, and the meter performed to its standard specification. All data points lie within an uncertainty (or accuracy) band of $\pm 0.75\%$ which is better than the documented uncertainty of this product ($\pm 1.0\%$), and repeat data points taken show excellent repeatability and meet the product specification of $\pm 0.1\%$.

Figure 1-1. Major Components–Rosemount 3051SFC Flowmeter

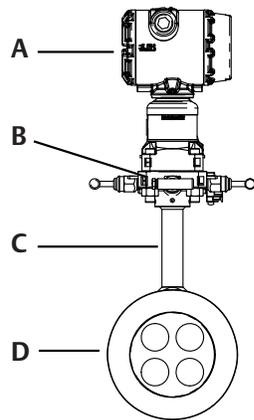


- A. Differential pressure transmitter
- B. Integral head
- C. Neck
- D. Conditioning orifice

Figure 1-2. Discharge Coefficient vs. Reynolds Number

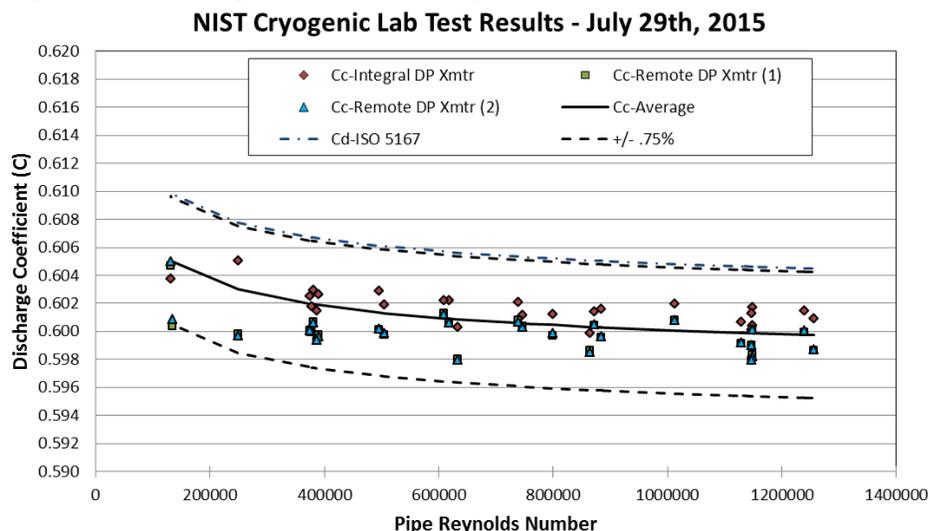

During the flow calibration, temperature readings were also taken from various points on the meter to determine the ideal orientation as well as to prove that the transmitter remains in the operable temperature range while installed in cryogenic flow. Under ambient conditions of 77 °F (25 °C), the integrally mounted transmitter remained at or above 60 °F (16 °C) as shown on the graph below. During testing, temperatures were recorded at the locations noted in [Figure 1-3](#).

Figure 1-3. Locations of Temperature Recordings

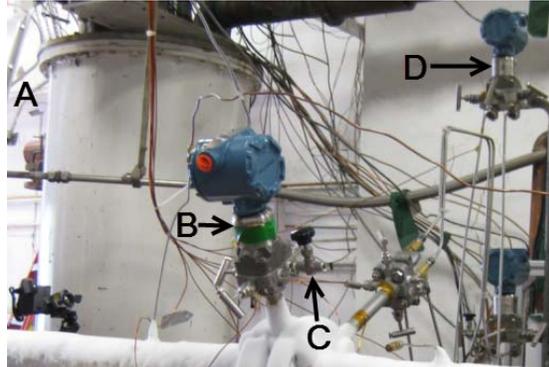


- A. Ambient temperature
- B. Integral mount transmitter temperature
- C. Integral mount head temperature
- D. Remote mount transmitter temperature

From these results, a minimum safe ambient operating temperature of 40 °F (4 °C) is expected. Below this temperature, provisions should be made with either heat tracing or a heated enclosure to maintain this temperature at the transmitter.

Figure 1-4. Time vs. Transmitter Temperature

NIST Cryogenic Lab Test Results - July 29, 2015

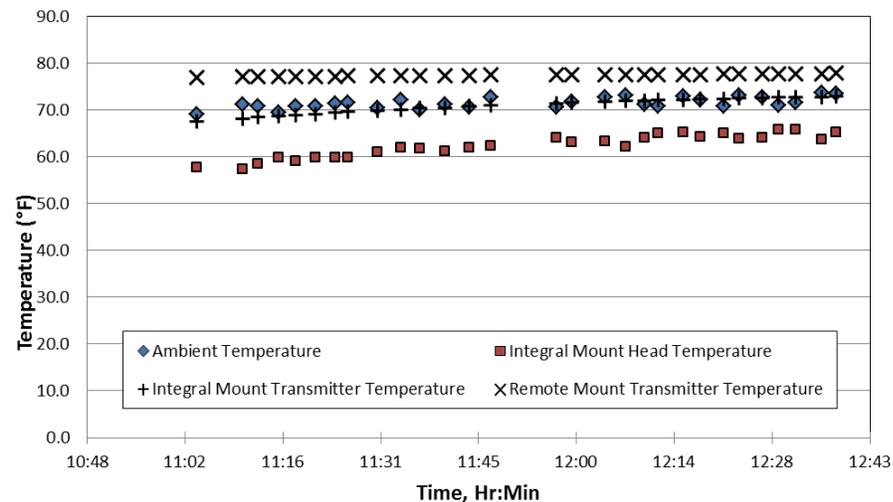

4.0 Installation best practices

- No special materials for O-rings or transmitter diaphragms are required.
- To ensure a gas barrier between the transmitter and cryogenic liquid, the flowmeter should be mounted within 45° of the top of the pipe for horizontal flow. This would be between the 10 o'clock and 2 o'clock positions. Vertical flow orientations are not recommended unless the transmitter is remotely mounted.
- The flowmeter can be used down to ambient temperatures of 40 °F (4 °C) provided the head and neck are uninsulated. Below this temperature, provisions should be made to maintain the temperature of the transmitter above 40 °F.
- If the piping is insulated, the neck of the flowmeter and transmitter should remain uninsulated to maintain a proper operating temperature.
- For remote mounting, ¼-in. tubing should be used and the transmitter mounted at least 12 inches above the primary element.



FLIR image of flowmeter during cryogenic testing

5.0 Conclusion

When used according to this note's installation best practices, the Rosemount 3051SFC will perform to its documented specifications in cryogenic liquids without any modifications to the standard product. Cryogenic liquids included in this statement are Liquid Nitrogen (LN2), Liquefied Natural Gas (LNG), and Liquid Argon (LAR). For other gases not listed above, such as Oxygen (LOX), consult your local Emerson Representative.

6.0 Other resources

The ability to handle cryogenic liquids is just one of the many benefits of using Rosemount Differential Pressure Flowmeters to help improve performance of your operation. To learn more about these benefits, contact your local Emerson Representative or visit EmersonProcess.com/Rosemount.

Global Headquarters

Emerson Process Management

6021 Innovation Blvd.

Shakopee, MN 55379, USA

+1 800 999 9307 or +1 952 906 8888

+1 952 949 7001

RFQ.RMD-RCC@EmersonProcess.com

North America Regional Office

Emerson Process Management

8200 Market Blvd.

Chanhassen, MN 55317, USA

+1 800 999 9307 or +1 952 906 8888

+1 952 949 7001

RMT-NA.RCCRFQ@Emerson.com

Latin America Regional Office

Emerson Process Management

1300 Concord Terrace, Suite 400

Sunrise, FL 33323, USA

+1 954 846 5030

+1 954 846 5121

RFQ.RMD-RCC@EmersonProcess.com

Europe Regional Office

Emerson Process Management Europe GmbH

Neuhofstrasse 19a P.O. Box 1046

CH 6340 Baar

Switzerland

+41 (0) 41 768 6111

+41 (0) 41 768 6300

RFQ.RMD-RCC@EmersonProcess.com

Asia Pacific Regional Office

Emerson Process Management Asia Pacific Pte Ltd

1 Pandan Crescent

Singapore 128461

+65 6777 8211

+65 6777 0947

Enquiries@AP.EmersonProcess.com

Middle East and Africa Regional Office

Emerson Process Management

Emerson FZE P.O. Box 17033

Jebel Ali Free Zone - South 2

Dubai, United Arab Emirates

+971 4 8118100

+971 4 8865465

RFQ.RMTMEA@Emerson.com

 [Linkedin.com/company/Emerson-Process-Management](https://www.linkedin.com/company/Emerson-Process-Management)

 [Twitter.com/Rosemount_News](https://twitter.com/Rosemount_News)

 [Facebook.com/Rosemount](https://www.facebook.com/Rosemount)

 [Youtube.com/user/RosemountMeasurement](https://www.youtube.com/user/RosemountMeasurement)

 [Google.com/+RosemountMeasurement](https://www.google.com/+RosemountMeasurement)

Standard Terms and Conditions of Sale can be found at

www.Emerson.com/en-us/pages/Terms-of-Use.aspx

The Emerson logo is a trademark and service mark of Emerson Electric Co. Rosemount and Rosemount logotype are trademarks of Emerson Process Management.

All other marks are the property of their respective owners.

© 2016 Emerson Process Management. All rights reserved.