

Use these instructions to install ENVIRO-SEAL packing in valves that have standard packing or when inspecting or replacing ENVIRO-SEAL packing.

WARNING

Avoid personal injury or property damage from sudden release of process pressure or bursting of parts. Before performing any maintenance operations:

- **Disconnect any operating lines providing air pressure, electric power, or a control signal to the actuator. Be sure the actuator cannot suddenly open or close the valve.**
- **Use bypass valves or completely shut off the process to isolate the valve from process pressure. Relieve process pressure from both sides of the valve. Drain the process media from both sides of the valve.**
- **Vent the pneumatic actuator loading pressure and relieve any actuator spring precompression.**
- **Use lock-out procedures to be sure that the above measures stay in effect while you work on the equipment.**

If you are installing the system in a valve that is still connected to an actuator, remove the actuator from the valve to provide sufficient space to install the packing assembly. If a spring-return actuator is used, it is possible that disconnecting the stem connector will allow the spring to force the actuator to the end of its travel. Be sure the actuator spring is resting on its travel stop. Refer to the appropriate valve and actuator instruction manuals to remove the actuator.

Pressures and Temperatures

Maximum to Maintain Leakage of Less Than 500 ppm: Full ANSI Class 600 pressures to 600°F (316°C)

1. Carefully remove the old packing parts from the packing box. The surface condition of the valve stem and the packing box wall is critical in obtaining a good seal. If the valve stem needs to be replaced, or any other valve part, refer to the appropriate valve instruction manual for replacement procedures. Complete all valve maintenance before installing the ENVIRO-SEAL packing system into the bonnet.
2. If a retrofit kit is being installed in place of the original packing, it may be necessary to remove the old studs from the valve because they are too short. Check stud length by installing the packing and the spring pack assembly using the following assembly procedures, and try installing

the packing nuts. If the packing nuts will not start on the threads of the studs, it will be necessary to install new studs and nuts from the retrofit kit.

Note

Ensure that the packing box parts are assembled in the correct order. Packing parts can not function properly if the Belleville springs or other packing parts are not stacked correctly.

3. Use the drawing provided to ensure that the packing parts are assembled in the correct order. Install the ENVIRO-SEAL packing parts into the packing box.
4. Install the spring pack assembly (key 217), which includes the attached springs, and packing flange (key 201), on the stem. Install the nuts (key 212) and hand tighten them.

Note

Lubrication is required for the packing studs and nuts.

Although it is important to properly lubricate the stud threads and internal nut threads, it is also important to properly lubricate the contacting face of the nut.

5. You will obtain maximum benefit from your ENVIRO-SEAL packing system when you tighten the packing flange nuts and compress the Belleville springs to their “target load.” The target load is the point where the Belleville springs are designed for optimum performance, when they are compressed to 85% of their maximum deflection, or nearly flat. (Maximum deflection is when the springs are 100% compressed, or completely flat.)

To obtain the target load of 85% compression of maximum deflection, perform the following:

- Tighten the packing flange nuts alternately and evenly, keeping the packing flange parallel with the valve flange, until the Belleville springs are compressed 100% (or completely flat). Refer to the instruction manual for ENVIRO-SEAL packing systems for sliding stem valves if you need further assistance.


- For graphite packing, loosen each packing flange nut 1/4 turn (90 degrees rotation).

The “target load” of 85% compression has now been reached.

6. Refer to the appropriate valve and actuator instruction manuals when connecting the valve to the actuator. Under normal conditions, the packing nuts should not require re-tightening.

PACKING RETROFIT	PACKING REPAIR	STEM SIZE DIAMETER, IN. (mm)
RPACKXRTX062	RPACKX00242	3/8 (9.5)
RPACKXRTX072	RPACKX00252	1/2 (12.7)
RPACKXRTX082	RPACKX00262	3/4 (19.1)
RPACKXRTX092	RPACKX00272	1 (25.4)
RPACKXRTX102	RPACKX00282	1-1/4 (31.8)

For additional information concerning the installation of this packing kit, please consult the appropriate Fisher Controls product instruction manual.

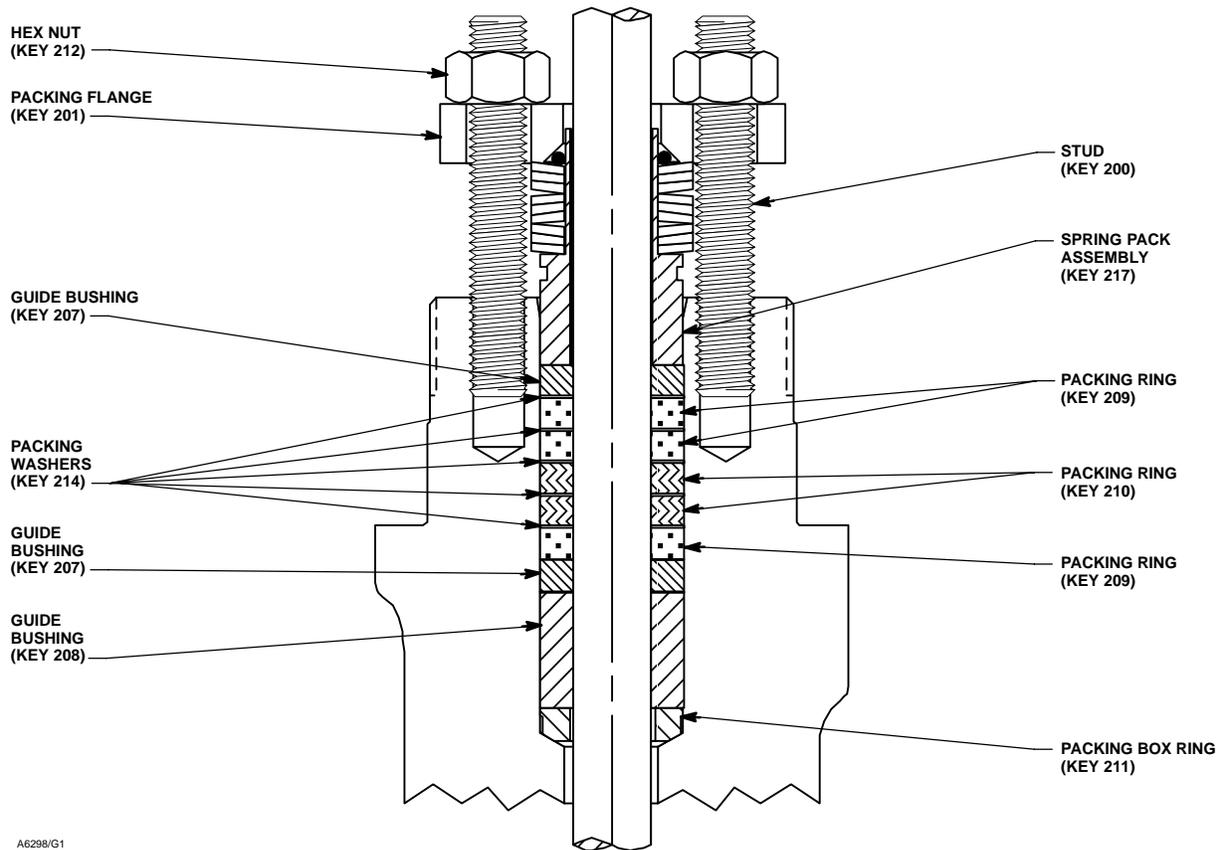

**3/8-INCH (9.5 mm) THROUGH
 1-1/4 INCH (31.8 mm) STEM SIZES**

Stems and packing box constructions that do not meet Fisher Controls stem finish specifications, dimensional tolerances, and design specifications, may adversely alter the performance of this packing kit.

While this information is presented in good faith and believed to be accurate, Fisher Controls does not guarantee satisfactory results from reliance upon such information. *Nothing contained herein is to be construed as a warranty or guarantee, express or implied, regarding the performance, merchantability, fitness*

or any other matter with respect to the products, nor as a recommendation to use any product or process in conflict with any patent. Fisher Controls reserves the right, without notice, to alter or improve the designs or specifications of the products described herein.



Fisher Controls

For information, contact Fisher Controls:
 Marshalltown, Iowa 50158 USA
 Cernay 68700 France

Sao Paulo 05424 Brazil
 Singapore 2158