

High Process Noise Diagnostic Improves Measurement Reliability and Lowers Maintenance Costs

RESULTS

- Reduced process variability
- Reduced maintenance costs by \$6,000 annually
- Improved measurement reliability and product quality
- Improved throughput by decreasing overall batch time



The DA1 high process noise diagnostic improved measurement stability without increased damping, to reduce overall batch time.

APPLICATION

Water Flow-Slurry

APPLICATION CHARACTERISTIC


Molecular sieve water removal consisting of 5-10% polymer solids

CUSTOMER

A major chemical company

CHALLENGE

A major chemical company was using another manufacturer's magnetic flowmeters on their molecular sieve water removal lines. The process has a 5-10% polymer solids content which resulted in a noisy flow signal. Operators logged three trouble calls per year for each of the four magmeters. Each time operations complained of an erratic flow rate, technicians did not find any instrument problems. For the twelve work orders per year, this customer estimated they spent \$6,000 in maintenance cost to try and locate the source of the erratic flow rate. Due to the noisy flow signal and the inability of the installed magmeters to filter the noise, or provide any diagnostic information to remedy the noise issue, they had to dampen the output to get a stable signal. This resulted in delayed response time, put the process at risk for reduced quality, and could have potentially damaged downstream mechanics. Since the amount of slurry feed is critical to their process, operators were required to perform visual inspections on the reactors to ensure product quality for every batch.

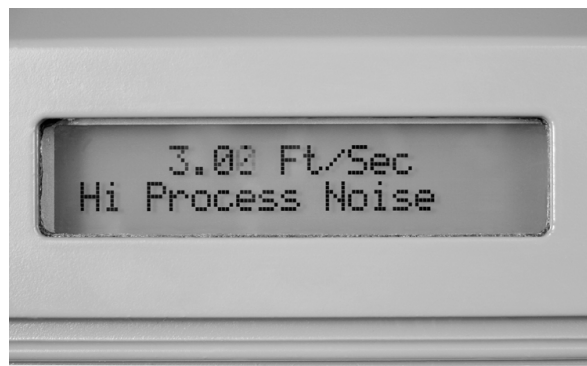

High Process Noise Diagnostic

SOLUTION


The Rosemount 8732 transmitter with the DA1 high process noise diagnostic option gave this customer the ability verify the noise levels within the process, allowing for quick and easy troubleshooting. The high process noise diagnostic can be run from the local operator

ROSEMOUNT

For more information:
www.rosemount.com


EMERSON
 Process Management

interface or AMS® Suite. The DA1 high process noise diagnostic provided a signal to noise ratio at both 5 Hz and 37 Hz. Emerson recommends that the signal to noise ratio be greater than 25 when flow is present. Seeing that the signal to noise ratio at 5 Hz was substantially less than at 37 Hz, maintenance technicians changed the coil drive frequency to 37 Hz in order to reduce the variability in the output without having to add any damping. The more stable output provided tighter control of the slurry feed, which eliminated the need for visual inspection of the reactors and decreased the overall batch times. Not only did the DA1 high process noise diagnostic solve the problem, the technicians were able to fix the problem without shutting down the process. In addition, this customer would remove their previously installed flowmeters for inspection and cleaning once per year costing \$6,000. With the diagnostic information provided by the Rosemount 8732 transmitter, this customer knows their magmeters are working as intended, and they have eliminated this practice from their yearly maintenance procedures.

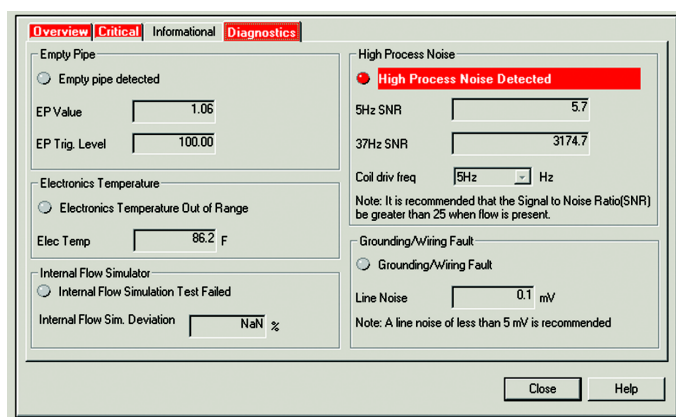

High Process Noise Diagnostic in AMS Suite

RESOURCES

Emerson Process Management Chemical Industry

<http://www2.emersonprocess.com/en-US/industries/Chemical/Pages/index.aspx>

Rosemount E-Series Magnetic Flowmeter Transmitters

<http://www2.emersonprocess.com/en-US/brands/rosemount/Flow/Magnetic-Flowmeters/E-Series-Transmitters/Pages/index.aspx>

The contents of this publication are presented for information purposes only, and while effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, expressed or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which can be found at www.rosemount.com/terms_of_sale. We reserve the right to modify or improve the designs or specifications of our products at any time without notice.

The Emerson logo is a trade mark and service mark of Emerson Electric Co. Rosemount and the Rosemount logotype are registered trademarks of Rosemount Inc. PlantWeb is a registered trademark of one of the Emerson Process Management group of companies. All other marks are the property of their respective owners.

**Emerson Process Management
Rosemount Inc.**
8200 Market Boulevard
Chanhausen, MN 55317 USA
www.rosemount.com
Tel (USA) 800 522 6277
Tel (International) +1 (303) 527 5200
Fax +1 (303) 530 8459

**Emerson Process Management
Flow B.V.**
Neonstraat 1
6718 WX Ede
The Netherlands
T +31 (0) 318 495555
F +31 (0) 318 495556

Emerson FZE
P.O. Box 17033
Jebel Ali Free Zone
Dubai UAE
Tel +971 4 811 8100
Fax +971 4 886 5465

**Emerson Process Management Asia
Pacific Private Limited**
1 Pandan Crescent
Singapore 128461
T (65) 6777 8211
F (65) 6777 0947
Enquiries@AP.EmersonProcess.com

**Emerson Process Management Latin America
Multipark Office Center**
Multipark Office Center
Turrubares Building, 3rd & 4th floor
Guachipelin de Escazu, Costa Rica
T+(506) 2505-6962
international.mmicam@emersonprocess.com



For more information:
www.rosemount.com

