



## KEYSTONE K-LOK® SERIES 360/362 AND 370/372

### INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

Before installation these instructions must be fully read and understood



#### GENERAL

Suggested installation orientation is with valve shaft horizontal or inclined from vertical. Unless otherwise recommended by Emerson, mount the valve in the preferred direction with the directional arrow pointing to the lower pressure side so that the front face of the disc will be upstream when the valve is in the closed position.

Thermal insulation of the body is mandatory for operating temperatures above 200°C (392°F).

K-LOK offers the following body styles:

Wafer - Figures 360 and 370

Lug/Single Flange - Figures 362 and 372

Double Flange - Figures 364 and 374

#### INSPECTION

1. Carefully remove the valve from the shipping package (box or pallet) to avoid any damage to the valve and, in the case of automated valves, to the electric or pneumatic/hydraulic actuator or instrumentation.
2. Prior to installation, clean the inside of the valve. Insure that there are no solid objects such as pieces of wood, plastic or packing materials within the valve or on the valve seat.
3. Inspect the seat and disc edge to insure that they were not damaged in handling. This is especially important in the case of valves with "fail-open" actuators.

4. Confirm that the materials of construction listed on the valve nameplate are appropriate for the service intended and are as specified.
5. Locate the directional arrow on the body that defines the preferred mounting orientation in respect to the pressure. In most cases, the valve is properly installed when the actual fluid flow or high pressure is acting on the front face of the disc when the valve is closed.
6. Ensure that the packing gland bolting nuts are tight.
3. Insert a bolt or stud through the flange and thread it into the holes in the valve body. This will allow the valve to center itself properly for the installation of the flange gaskets.
4. Install the flange gaskets and the remaining flange bolting.
5. Use the crossover method to tighten all flange bolting.

#### CAUTION

*The valve should be installed in the closed position to insure that the seat and disc are not damaged during installation. Particular care should be taken with valves equipped with "fail open" actuators. Failure to insure proper handling may result in damage to the valve. If the pipe is lined, confirm that the disc rotation does not contact the lining during the opening stroke. Failure to confirm that the disc rotation does not contact the lining may result in damage to the valve.*

#### IMPORTANT

*Whenever possible, install the valve with the shaft in the horizontal position and, if possible, with the cast-in disc stop located top-side of the pipe. If the shaft cannot be positioned horizontally, position the shaft so that it is not on the vertical centerline in a horizontal pipe run. This will minimize any depositing of solid particles present in the fluid into the lower bearing.*

#### INSTALLATION

The valves are shipped with flange gasket surface protection. Before installing the valve, remove the protection and carefully clean and de-grease both surfaces with a solvent.

##### Lug series - Series 362 and 372

1. Orient the valve with the directional flow arrow (preferred direction) pointing in the proper direction.
2. Insert the valve between the flanges until the two bottom holes in the valve align with the two lower flange holes.

# KEYSTONE K-LOK® SERIES 360/362 AND 370/372

## INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

### Wafer series - Series 360 and 370

1. Orient the valve with the directional flow arrow (preferred direction) pointing in the proper direction.
2. Insert the valve between the flanges until the alignment holes at either side of the valve match the corresponding holes in the flanges.
3. Insert a long bolt or stud through the flange and thread it through the alignment hole. This will allow the valve to center itself properly for the installation of the flange gaskets.
4. Install the flange gaskets and the remaining flange bolting.
5. Remove the long bolts/studs from the lower alignment holes and replace with correctly-sized bolts.
6. Using the crossover method, tighten all flange bolts.

### VALVE CHECKOUT

1. Tighten the packing gland bolting just enough to prevent stem leakage. Over-tightening will decrease packing life and increase operating torque requirements.
2. Check the operation of the valve by stroking it to "full open" and "full close". To determine the valve orientation of the disc, double D's and keyways are aligned with the disc. The valve disc travels clockwise to close.
3. For automated valves, set the air pressure/electrical voltage for at least the minimum given to operate the actuator. For pneumatic actuators, do not apply more than 1.25 times the pressure for which the actuator was designed.

**Note:** for spring return actuators with positioners, overpressure will cause excessive time delay in the spring movement for the valve disc to travel out of the seat.

### OPERATION

The K-LOK has been designed to require a minimum of maintenance. Generally, only maintenance on the packing box is required.

### MAINTENANCE

If shaft leakage is observed through the packing box, tighten the gland nuts.

**Note:** do not over-tighten packing box gland nuts. Over-tightening will increase the torque required to operate the valve. When tightening the gland nuts, use half-turn increments until leakage has stopped.

### DISASSEMBLY

To begin disassembly, refer to the parts list (Figure 2) and proceed as follows:

#### WARNING

*Depressurize the valve and associated piping before disassembly. Failure to do so may cause serious personal injury and/or equipment damage.*

1. Remove the valve from the line.  
Clean the valve according to proper cleaning procedures as outlined by the plant or according to a prescribed procedure.
2. Remove the actuator and relevant connecting key. Note the actuator position relative to the valve.

#### CAUTION

*Throughout disassembly and assembly, always use cardboard or brass shims to protect the valve body, disc, flange and sealing surfaces from damage. Failure to do so may result in serious damage to the valve.*

#### Removing the disc-to-stem tapered pin connections

1. Open the valve disc (2A) to its full open position.

**Note:** on valve sizes NPS 10 and larger, it is recommended that two workers perform the disc tapered pin (2D) removal process.

2. Place the disc in a vise.
3. Using a tool steel punch, locate the punch on the small end of the disc taper pin (2D) and then strike the punch with a heavy hammer. [See Figure 1]

**Note:** some of the weld on the three disc taper pins (2D) may need to be removed by grinding.

#### WARNING

*When placing the valve into the bench vise, make sure the small end of the disc (2A) taper pin faces the assembler.*

*Hold the punch with a punch holder or a pair of vise grips. Otherwise, serious injury may occur.*

#### Removing the bottom cover assembly

To disassemble the bottom cover assembly, remove the following bottom cover assembly components:

- Bottom cover plate (7)
- Thrust washer (10)
- Bottom cover gasket (16)
- Washer (18)
- Screw (17)

FIGURE 1


Shows the valve properly clamped in place



# KEYSTONE K-LOK® SERIES 360/362 AND 370/372

## INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

FIGURE 2

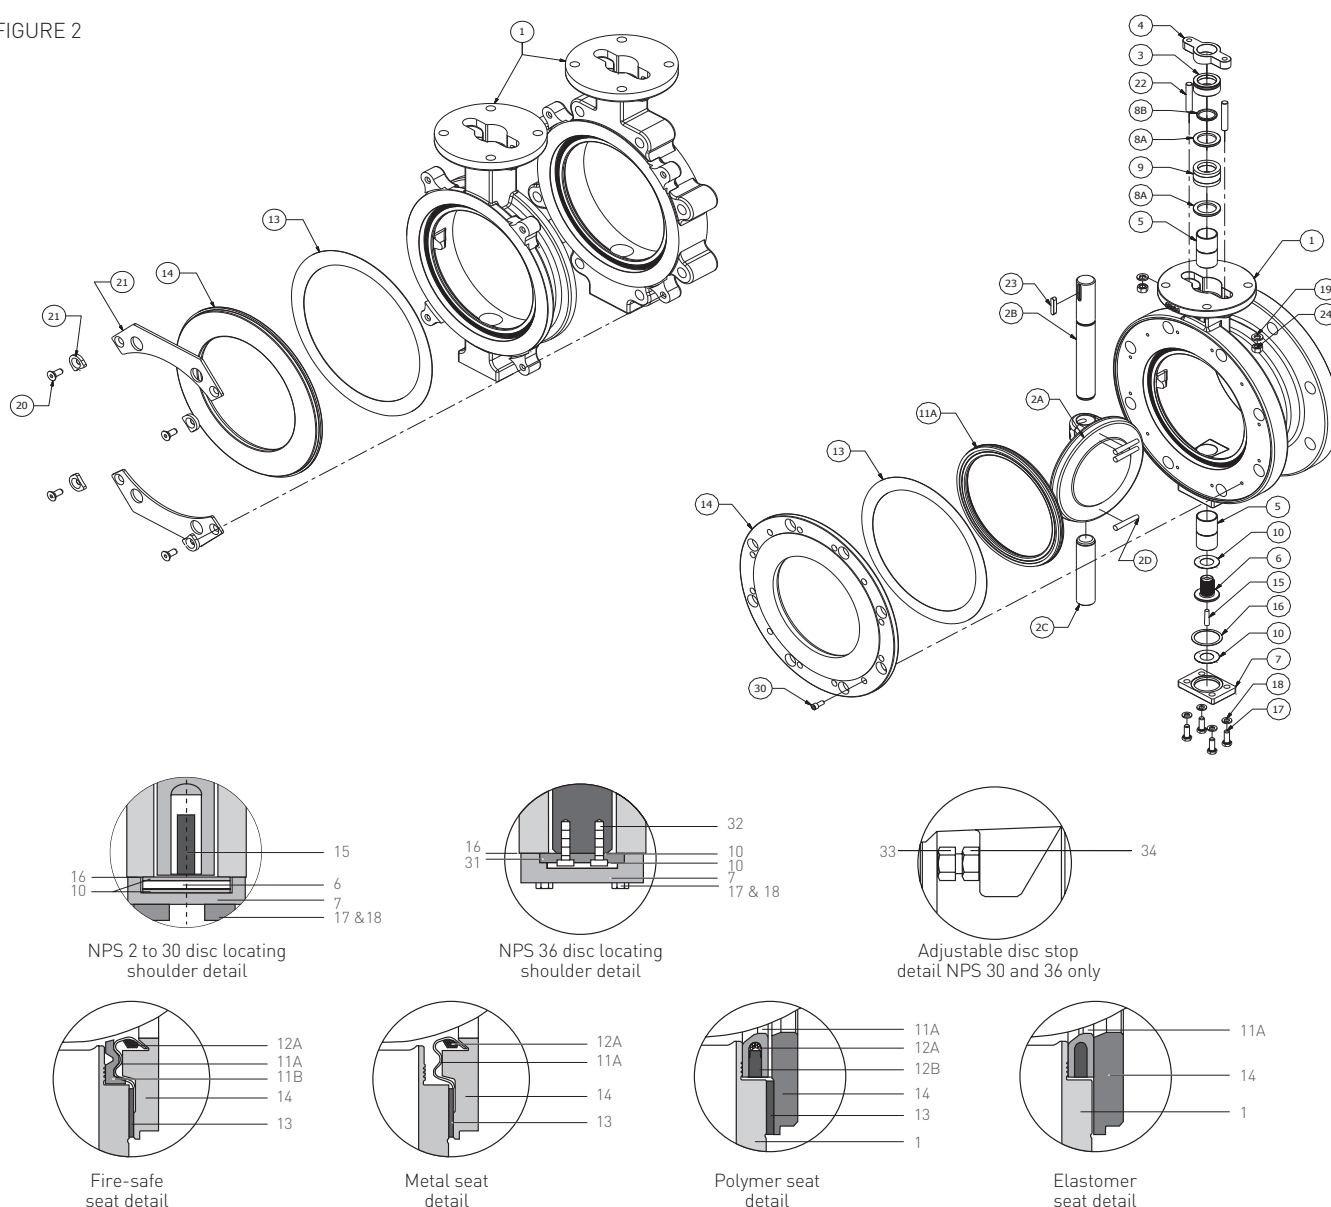

### Parts list

1	Body	11A	Seat	23	Key [8" to 36"]
2A	Disc	11B	Fire-safe seat insert	24	Hex nut
2B	Upper stem	12A	Seat backing wire	25	I.D. tag (not shown)
2C	Lower stem	12B	Seat backing ring	26	Flow tag (not shown)
2D	Disc taper pin	13	Retaining ring gasket	27	Strap tag (not shown)
3	Gland	14	Seat retaining ring	28	Strap tag (not shown)
4	Gland bridge	15	Shoulder taper pin (2" to 30")	29	Spacer (CL.150 : 26" to 30", CL.300 : 20" & 24" / not shown)
5	Bearing	16	Bottom cover gasket	30	Cap screw (wafer and lug : 30" to 36", D/F : 2" to 36")
6	Disc locating shoulder (2" to 30")	17	Bottom cover screw	31	Thrust plate (32" and 36")
7	Bottom cover	18	Lock washer (spring)	32	Screw (32" and 36")
8A	Anti extrusion ring	19	Lock washer (spring)	33	Screw (30" to 36")
8B	Circle clip	20	Clip screw	34	Nut (30" to 36")
9	Packing set	21	Clip or locating plate		
10	Thrust washer	22	Gland bridge stud		

# KEYSTONE K-LOK® SERIES 360/362 AND 370/372

## INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

### Removing the lower stem assembly

#### CAUTION

Throughout this operation, make sure the disc edges remain protected from contact with the body by installing cardboard at all disc hub areas. Failure to do so may cause damage to the disc sealing edge.

1. Spray penetrating oil into the disc hub where it meets the stem connection.
2. Locate a wedge-shaped chisel/punch between the disc locating shoulder (6) position and the body (1) bottom surface. [See Figure 3]
3. Strike the chisel/punch to force the disc locating shoulder (6) away from the valve body (1) surface.
4. Continue to wedge apart the lower stem assembly, via the disc locating shoulder (6), until the lower stem (2C) is free of the disc (2A).
5. Lightly strike the backside of the disc hub area with a hammer if the stem is resistant to removal.

### Removing the packing gland assembly

1. Unthread the nuts (24) from the packing bridge studs (22).
2. Remove the packing gland bridge (4).

### Removing the upper stem and disc

#### CAUTION

Throughout this operation, make sure the disc edges remain protected from contact with the body by installing cardboard at all disc hub areas. Failure to do so may cause damage to the disc sealing edge. Protect the stem from the vise teeth to prevent damage and to eliminate potential for packing leakage.

1. When removing the upper stem (2B) from the disc (2A), clamp the vise jaws on to the upper stem (2B) area above the valve body top plate.
2. Once the vise jaws are secure against the upper stem (2B), drive the wedge-shaped chisel/punch between the valve body (1) top plate and the bench vise. [See Figure 4]
3. As the valve body (1) moves away from the bench vise, the upper stem (2B) is removed from the upper disc (2A) hub.
4. Continue to reposition the valve body (1) with the bench vise so as to allow removal of upper stem (2B).

#### CAUTION

Physically hold the disc to prevent the disc from falling and becoming damaged during removal. When both the upper stem (2B) and lower stem (2C) are removed from the disc (2A), the disc is unsupported.

#### WARNING

Smaller discs may be removed by hand (NPS 2 to 8). Remove larger discs with proper hoisting equipment. Failure to do so may result in personal injury or damage to equipment.

FIGURE 3

Shows the proper placement of the disc locating shoulder and the body bottom surface

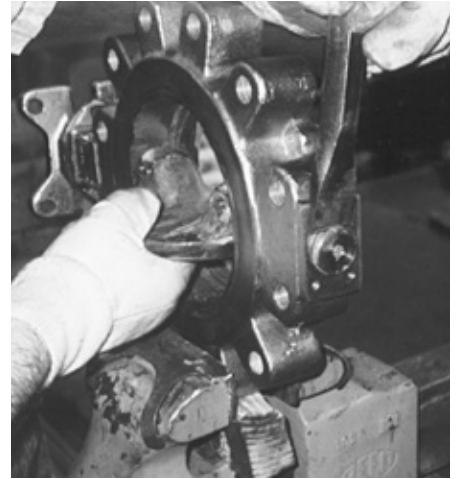


FIGURE 4

Shows how the upper stem is removed from the upper disk hub



# KEYSTONE K-LOK® SERIES 360/362 AND 370/372

## INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

### Removing the seat retaining ring

Removing the seat retaining ring (14) by removing the cap screw (30) for double flanged body, or clip screw (20) from the locating plates (21) or clip (21) for the lugged or wagger body. (See Figure 5).

### Removing the seat retaining gasket

Remove the seat retaining gasket (13). Use a powered wire brush tool to remove the gasket material that may have adhered to the mating body surfaces.

### Removing the seat assembly

To remove the seat assembly, treat the seat (11) and its associated components as a single assembly by removing the following:

- Seat (11)
- Wire wrap (12A)
- Seat backing ring (12B)

### Removing the packing assembly

#### Method 1: for packing replacement with stem in body

Using the screws, grab and remove each packing ring, one at a time.

#### Method 2: packing removal with stem removed from body

To remove the packing set (9) with the upper stem removed, use a hook-type tool to pull out one packing ring at a time.

**Note:** to remove the packing set (9) with the upper stem (2B) still in the valve body (1), two long, slender screws are required. The screws must not have a diameter greater than 1/4" and must be at least six inches long. The most commonly used screws are "drywall screws."

### Removing the stem bushings

1. Insert the removal tool in the valve body (1) top plate area and down the upper stem journal until the tool contacts the upper stem bushing.

**Note:** a special bushing removal/installation tool is required to remove or install the stem bushings (5). The tool O.D. dimension should be as near in size as the valve stem bore I.D. dimension and have a Class 3 fit. Any Machinist Handbook can provide Class 3 tolerances.

2. Remove the upper stem bushing (5) by striking the tool with a hammer.
3. Insert the removal tool in the valve body (1) bottom plate area and down the lower stem journal until the tool contacts the lower stem bushing.
4. Strike the tool until the lower stem bushing (5) is clear of the lower body stem journal.

### Inspecting the valve components

1. After disassembly, visually inspect the seat retainer ring (14) and the bottom cover plate (7).
2. Make sure all body sealing surfaces:
  - are flat
  - are free of corrosion damage
  - have a smooth surface
  - are free of burrs.Remove any burrs with fine grit sandpaper.
3. Inspect for scratches around disc edges:
  - If scratched, smooth the edge with fine grit sandpaper (220/400 wet/dry sandpaper)
  - Remove the scratch by using a blending motion and extend the smoothed area at least two inches above, below and around the original scratch
  - To polish the disc edge, use a powered wire brush
  - Finish sand or polish the edge on a lathe, as required.
4. Check to see that the upper and lower (2B, 2C) stem-to-bushing (5) contact locations are free of galling.
5. Check to see that the upper (2B) stem-to-packing (9) contact area is free of scratches.

FIGURE 5  
Seat retainer ring and parts

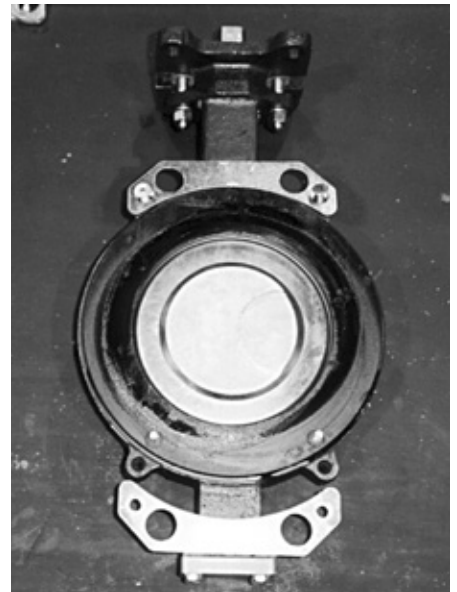


FIGURE 6  
Shows partial insertion of the stem bearing





# KEYSTONE K-LOK® SERIES 360/362 AND 370/372

## INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

### ASSEMBLY

**Note:** if scratched or galled, these surfaces should be polished or replaced.

#### Installing stem bushing

1. To avoid damaging the stem bushing (5), gently press the bushing into the stem body journal by lightly striking the bushing (5) with a rubber mallet.
2. Once the stem bushing (5) has been partially inserted into the valve body journal, insert the installation/removal tool against the upper stem bushing. (See Figure 6)
3. Strike the tool with a hammer to continue inserting the stem bushing until it is flush with the body flowpath surface. (See Figure 7)

#### Installing the disc/stem assembly

#### CAUTION

*To prevent damage to the disc, do not allow the disc edges to contact the body flowpath surface.*

1. Install the upper stem (2B) and lower stem (2C) into the valve body stem journals with the pinning grooves position on top of the stem side view.

**Note:** the upper and lower stems are correctly installed when the lower ends of the stems are flush with the body flowpath surface.

2. While holding the disc (2A) with the backside of the disc facing up and the double pin hub facing toward the body (1) upper stem journal, position the disc (2A) in the body (1).
3. Push the stems (2B and 2C) into the disc (2A) hub stem holes.
4. If required, rotate the stems until the stem tapered pin holes are in alignment with the disc (2A) hub tapered pin holes.
5. Manually push the disc tapered pins (2D) to install them through the disc hub tapered pin holes.
6. Install the packing set (see Installing the packing set).
7. Carefully drive the tapered pins (2D) firmly into the connection with a punch and hammer.

**Note:** original disc/stem assemblies may use the disc locating shoulder assembly (6, 10 and 15) installed with the lower stem (2C). In this case, the disc/stem assembly should already be centered and may not require any centering adjustment.

#### Installing the packing set

1. Install the anti-extrusion packing ring (8A), packing set (9), second anti-extrusion ring (8A), circle clip (8B), and packing gland (3) into the upper journal of the valve body (1).
2. Keeping the disc assembly (2) in the closed position and closely centered in the body bore, tighten the packing nuts (24). Nuts have been correctly tightened when the packing gland plate (4) is flush with the valve body (1) top plate.

#### Installing the disc locating shoulder assembly

1. Place a thrust washer (10) over the disc locating shoulder (6) neck. If the thrust washer (10) has PTFE fabric on one side, install the thrust washer with the PTFE fabric side in contact with the disc locating shoulder.
2. Making sure the disc (2A) is in the closed position, center the disc with the body seat pocket.
3. Measure the gap between the body seat pocket ID and the disc OD before locking the disc into position. These measurements are to be made at the disc hub sections. The gap measurements are to be within 0.020 inches of each other. (See Figure 8)
4. While keeping the disc centered, drive the disc locating shoulder (6) into the bottom hole of the lower stem (2C) until the disc locating shoulder (6) and the associated thrust washer (10) are pressing against the body (1) bottom surface.
5. Push the tapered pin (15) into the hole located in the bottom of the disc locating shoulder (6).
6. Lock the tapered pin (15) into position by driving it with a punch and hammer. (See Figure 9)

FIGURE 7

Shows the stem bushing flush with the flow path surface



FIGURE 8

Shows how to measure the gap between the body seat pocket ID and the disc OD



FIGURE 9

Shows how to lock the tapered pin into position



# KEYSTONE K-LOK® SERIES 360/362 AND 370/372

## INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

### Installing the bottom cover assembly

1. Place the bottom cover gasket (16) around the disc locating shoulder (6).
2. Place a thrust washer (10) in the bottom cover plate (7). If the thrust washer (10) has PTFE fabric on one side, install the thrust washer with the PTFE fabric facing out from the bottom cover plate (7).
3. Align the bottom cover plate (7) with the body (1) bottom surface, making sure the bottom cover gasket (16) remains in alignment with the bottom cover plate (7) gasket groove.
4. Tighten the four bolts and washers (17, 18).

### Installing the standard seat assembly

1. Check to make sure the disc (2A) is in the closed position.
2. Make sure the disc is centered in relation to the body seat pocket.
3. Reset the disc locating shoulder pin (15) into its correct locked position by using a hammer and punch.
4. Put the seat retaining ring gasket (13) on the valve body (1) gasket surface. (See Figure 10).
5. Install the seat assembly.

**Note:** elastomer seated trims do not require a seat retainer gasket (13).

6. Insure the disc (2A) is closed against the body (1) disc stop.
7. Place the seat retaining ring (14) on top of the seat retaining ring gasket (13) and seat assembly (11 and 12).
8. Place the locating plates (21) and/or clips (28 for wafer style; 21 for lug) on the valve body.
9. Install and tighten the screws (20 or 30).

### CAUTION

*The standard seat retainer screws provide only enough force to hold the seat retainer ring (14) for shipment and installation. If valve actuation is required before installation, press the seat retainer into the seat to prevent damage to the valve seat before actuation.*

10. Press the seat retainer ring into the seat (11 and 12) and body (1) using two C-clamps to provide the needed compressive load. To press the seat retaining ring with the C-clamps, place the C-clamps on the valve assembly to allow an even load to be applied all around the seat retaining ring (14) and tighten until the seat retaining ring gasket (13) is compressed.
11. With the C-clamps pressing the seat retaining ring (14) into the gasket (11). Tighten the screws (20 or 30).

### To install RTFE, PTFE and UHMWPE seats:

1. Place the seat backing ring (12B) into the seat (11).
2. Press the backing ring into the seat (11) until no gaps are present between the backing splits.
3. Rotate the seat assembly until the seat backing ring (12B) splits align with the body stem journals.
4. Place the seat assembly (11 and 12) into the valve body (1) seat pocket. The seat assembly is correctly placed when the "V" groove on the side of the seat (11) is facing toward the assembler.

### To install NBR, EPDM and fluoroelastomer (FKM) seats:

1. Place the seat assembly (11) into the valve body (1) seat pocket.
2. Make sure the taper on the seat (11) ID is facing down toward the disc (2A) sealing surface.

### To install fire-safe seats:

1. Place the RTFE seat insert (11A) into the grooves of the metal seat.
2. Place the seat assembly (11 and 12A) into the valve body (1) seat pocket.
3. Make sure the RTFE seat insert (11A) is facing down toward the disc (2A) sealing surface.

### To install metal seats:

Place seat assembly (11 and 12A) into the valve body (1) seat pocket.

### Installing bi-directional dead-end service polymer seat assembly

Additional steps are required before seat installation for RTFE, PTFE and UHMWPE polymer seats used in bi-directional dead-end service (See Figure 11). Before installing these types of seats, follow these steps:


1. If the valve requires an O-ring, place the O-ring in the seat pocket. Place a ¼" diameter bead of CANNING™ Marston Hylomar Gasket and Joint Compound, (Type PL32 Heavy Sealant) or equivalent around the seat pocket ID corner.

### CAUTION

*Do not use any gasket sealant in valves being prepared for oxygen, chlorine or silicone-free service. Use of gasket sealant in such applications will result in damage to the valve.*

FIGURE 10

Shows proper placement of seat retainer gasket

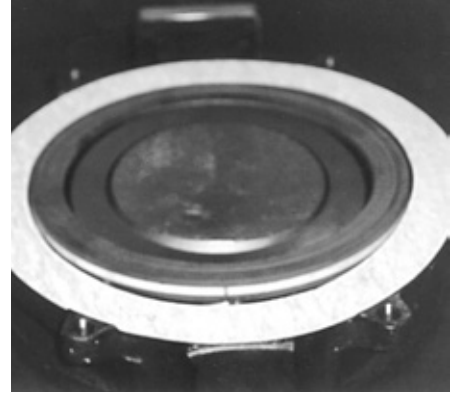

2. Install the seat assembly.
3. To allow the seat retainer ring dead-end service bolts to pass through the gasket (13), modify the seat retaining ring gasket (13) by following these steps:
  - a. Use the dead-end service seat retaining ring (14) to layout the bolt hole pattern.
  - b. Using a hole punch, make the required holes in the gasket.

### CAUTION

*To prevent damage to the valve when clamping, protect the body flange surfaces from the vise clamping surfaces with cardboard or brass shims.*

CANNING™ is a registered trademark of Wm. Canning Ltd., Marston Bentley Division, England.

# KEYSTONE K-LOK® SERIES 360/362 AND 370/372


## INSTALLATION, OPERATION, MAINTENANCE AND TROUBLESHOOTING

TABLE 1

Stem and pin material	Filler rod
17-4 pH 1075 HT	312 stainless steel
17-4 pH 1160 DHT (NACE)	312 stainless steel
316 stainless steel condition B	312 stainless steel
K Monel 500®	Monel®
Inconel®	Inconel

FIGURE 11

Shows dead-end service seat assembly.

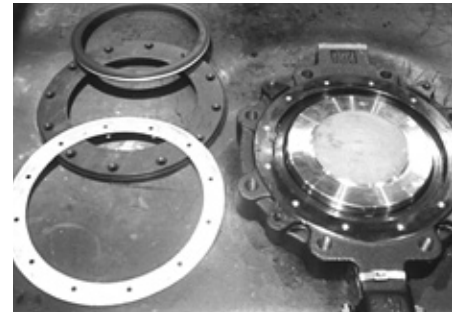

### TIG WELDING OF THE DISC TAPER PINS

1. After assembling and testing the valve, lock the three disc/stem taper pins (2D) by forcefully driving the tapered pins in place with a hammer and steel punch.
2. TIG weld the disc taper pins (2D). Weld using filler rod referenced in Table 1.

**Note:** sizes NPS 14 to 24 body valves employ both clips (28 for wafer and 21 for lug) and locating plates (21) to retain the seat retaining ring (14).  
Size NPS 30 and 36 wafer and lug body valves use seat retainer screws (30) instead of the hex socket flat head screws (20) with clips or locating plates. These seat retainer screws are located directly in the face of the seat. Two of these seat retainer screw holes are tapped. The two tapped holes allow the use of eye bolts so the seat retainer ring can be lifted to and from the body (1).

### TROUBLESHOOTING GUIDE

Symptom	Possible cause	Resolution
Valve won't rotate	<ol style="list-style-type: none"><li>1. Actuator has failed</li><li>2. Valve packed with debris</li><li>3. Stem key has sheared</li></ol>	<ol style="list-style-type: none"><li>1. Repair or replace</li><li>2. Flush or clean valve to remove debris</li><li>3. Determine cause of shearing and correct, replace</li></ol>
Stem packing leaking	<ol style="list-style-type: none"><li>1. Gland flange bolting loose</li><li>2. Packing damaged</li></ol>	<ol style="list-style-type: none"><li>1. Tighten gland flange bolting</li><li>2. Depressurize valve and replace packing</li></ol>
Bottom cover gasket leaking	<ol style="list-style-type: none"><li>1. Bottom cover bolting loose</li><li>2. Gasket damage</li></ol>	<ol style="list-style-type: none"><li>1. Tighten bottom cover bolting</li><li>2. Remove valve from service and replace gasket</li></ol>
Valve leaking	<ol style="list-style-type: none"><li>1. Valve not fully closed</li><li>2. Debris trapped in valve</li><li>3. Seat or disc edge damaged</li><li>4. Actuator mechanical closure stop incorrect</li></ol>	<ol style="list-style-type: none"><li>1. Close valve</li><li>2. Cycle and flush to remove debris</li><li>3. Remove valve from service and replace seat and/or repair or replace disc</li><li>4. Adjust the stop to allow further closure</li></ol>
Jerky operation	<ol style="list-style-type: none"><li>1. Stem/bearing damaged</li><li>2. Actuator/stem adapter misaligned</li><li>3. Overtightened packing</li><li>4. Air supply inadequate</li></ol>	<ol style="list-style-type: none"><li>1. Disassemble valve and inspect for damage, repair or replace damaged parts, reassemble</li><li>2. Remove actuator mounting and realign</li><li>3. Loosen packing to hand tight, cycle valve, retighten</li><li>4. Increase air supply pressure</li></ol>

Neither Emerson, Emerson Automation Solutions, nor any of their affiliated entities assumes responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use, and maintenance of any product remains solely with the purchaser and end user.

Keystone is a mark owned by one of the companies in the Emerson Automation Solutions business unit of Emerson Electric Co. Emerson Automation Solutions, Emerson and the Emerson logo are trademarks and service marks of Emerson Electric Co. All other marks are the property of their respective owners.

The contents of this publication are presented for informational purposes only, and while every effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available upon request. We reserve the right to modify or improve the designs or specifications of such products at any time without notice.